


MIN 6" CLASS 2
AGGREGATE BASE
UNDER SIDEWALKS AND
DRIVEWAY APPROACHES

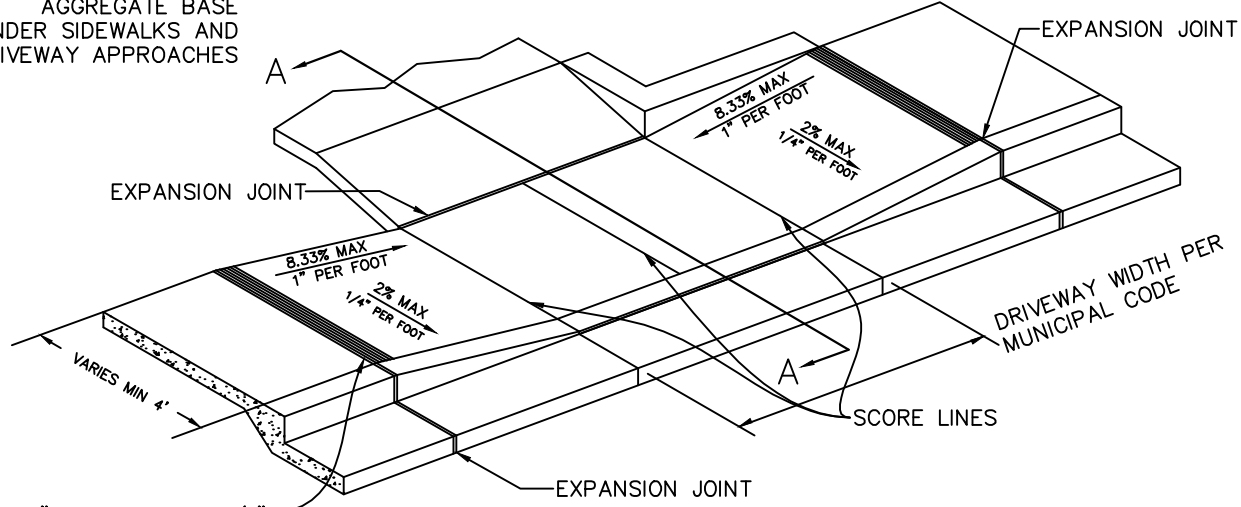

12" WIDE BAND OF 1/4"
DEEP GROOVES SPACED
3/4" ON CENTER

TYPE	CONCRETE THICKNESS
Residential	6"
Commercial	8" unreinforced or 6" with #4 rebar at 18" on center each way

NOTE:

1. Portion of asphalt concrete driveway within the right-of-way shall be a minimum 4" of asphalt concrete over minimum 6" of class 2 aggregate base compacted to 95% over competent soil compacted to apx. 90%.
2. Place 1/2" expansion joints at both sides of the connecting sidewalk and the at the back edge before pouring the driveway.
3. Place dowels into existing sidewalk, curb, and gutter.
4. See drawing No. 101A for general notes

<p>CITY OF PACIFICA PUBLIC WORKS DEPARTMENT ENGINEERING DIVISION</p>	<p>LOWERED DRIVEWAY APPROACH</p>				<p>AUG 2014</p>
					<p>DWG. NO. 102A</p>
		REV	DATE	BY:	