


Asphaltic concrete driveways shall be minimum of 2" A.C. over 4" crushed rock base on properly compacted soil or have a thickness of 4" A.C. over properly compacted soil.

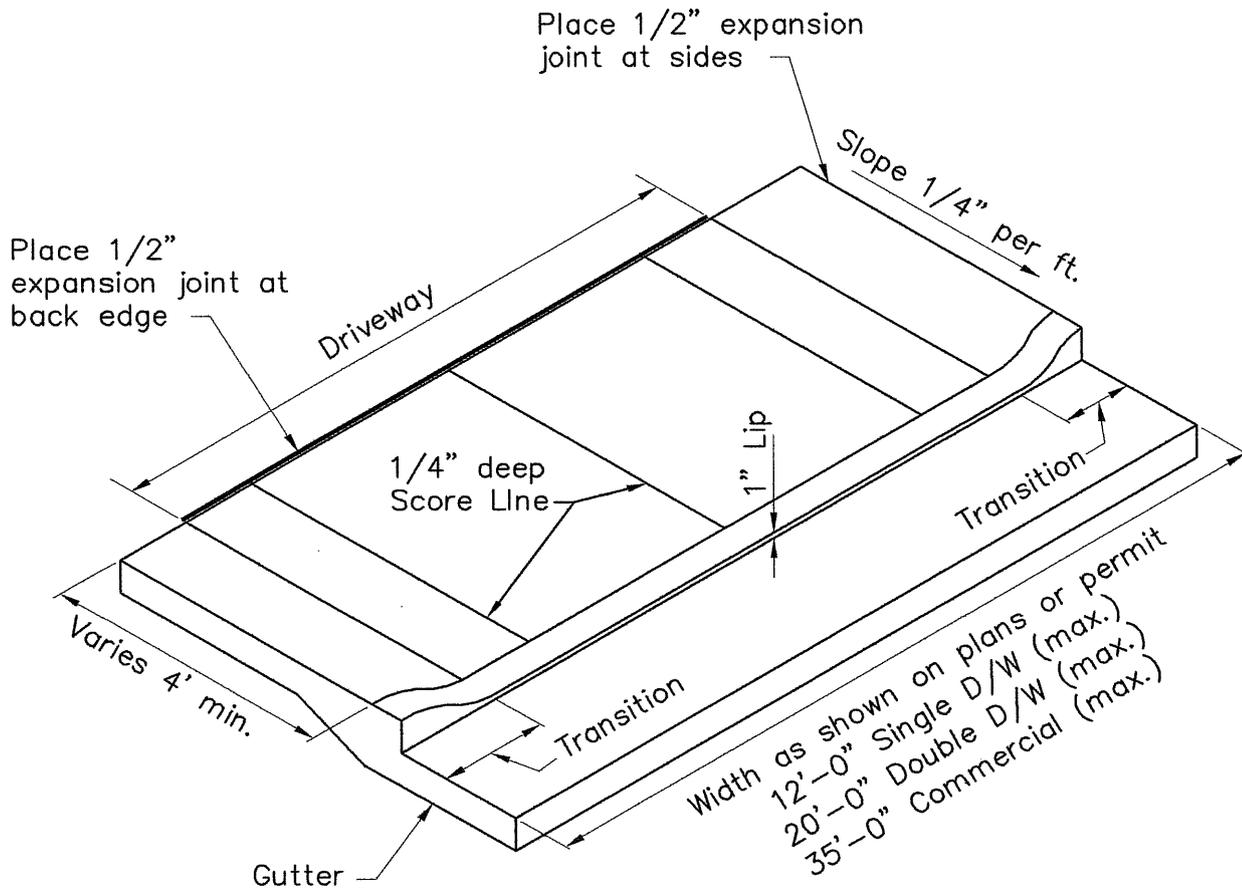

<u>TYPE</u>	<u>THICKNESS</u>	<u>TRANSITION</u>
Residential	6"	1'
Commercial	8" OR 6" with welded wire fabric	2'

NOTE: See Drawing No. 100 for general notes.

<b>CITY OF PACIFICA</b> DEPARTMENT OF PUBLIC WORKS ENGINEERING DIVISION	<u>STANDARD</u> <b>DRIVEWAY APPROACH</b> <b>RAMP</b>			MAY 1991
		5/91	VDO	DWG. NO. <b>102</b>
	REV	DATE	BY:	