




TYPE "A"

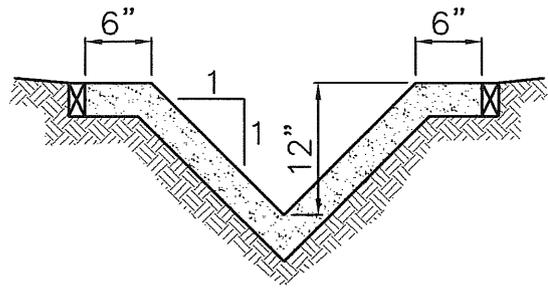

TYPE "B"

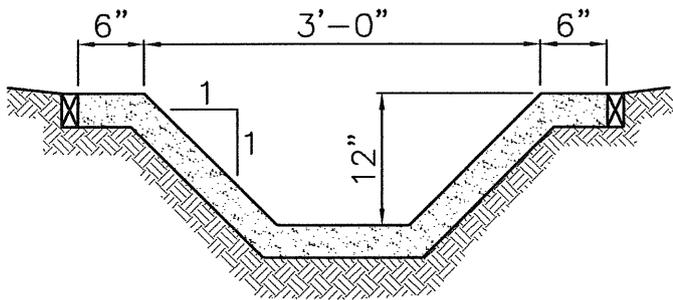

TYPE "C"

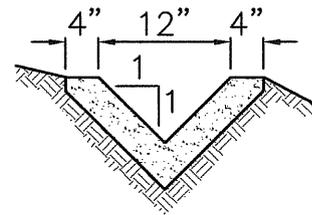

TYPE "D"

NOTE:

1. All sections shall be at least 4" thick.
2. Concrete shall be Class "B" (5 sack).
3. Both sides of the ditch shall be formed with 2"x4" lumber, WHERE SHOWN.
4. Concrete finish shall conform to Section 51-1.18A of the latest State Specification.
5. Ditch sides shall be back filled and compacted immediately after the removal of side forms.
6. No concrete shall be placed prior to form inspection by the Agency Engineer.
7. No ditch is to be constructed on filled ground prior to certification of the fill to the Agency by the Soil Engineer.
8. No expansion joints shall be required.

**CITY OF
PACIFICA**

**DEPARTMENT OF PUBLIC WORKS
ENGINEERING DIVISION**

**STANDARD
CONCRETE LINED
DITCHES**

3

2

1

REV

DATE

BY:

**SEPT.
1986**

**DWG. NO.
202**